


- NOTES:
- 1 LOCATE FITTINGS FROM PLAN VIEW,
  - 2 TANK(S) MUST BE INSTALLED PER ASSMANN CORPORATION USAGE & GUIDELINES.
  - 3 FLEXIBLE EXPANSION JOINTS MUST BE USED ON ALL SIDEWALL CONNECTIONS.
  - 4 TANKS ARE BUILT PER ASTM D 1998.

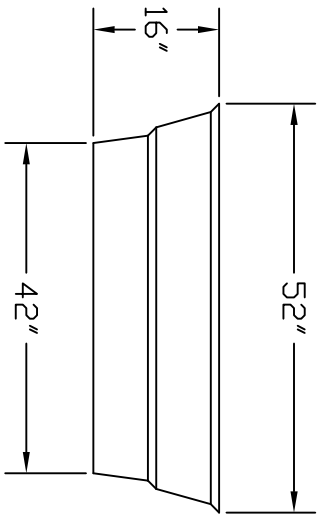

ACCESSORIES			
MK	SIZE	DESCRIPTION	DEG ELEV DOME

REV	REVISION DESCRIPTION	REV DATE

		300 N TAYLOR ROAD GARRETT, IN 46728 PHONE: (260) 357-3181 FAX: (260) 357-3739	
TITLE: IRD 185 GALLON RECTANGULAR SECONDARY CONTAINMENT BASIN			
DRAWN BY: SRUMLISON	CHECK DATE: 2/27/13	SALES ORDER	RESIN USED: POLYETHYLENE TANK DESIGNED SPECIFIC GRAVITY: 1.9 SP.G. MAX WEIGHT: 47 LBS.
DWG NUMBER: IRD 185	REV:	Ø	ALL DIMENSIONS ARE IN INCHES AND ARE ±3%