

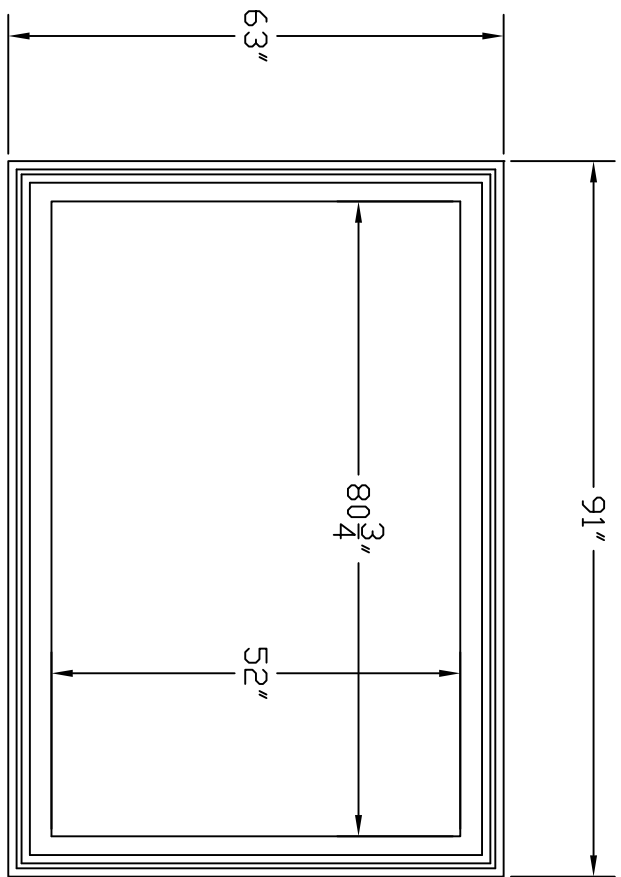


ACCESSORIES

MK	SIZE	DESCRIPTION	DEG	ELEV	DOME

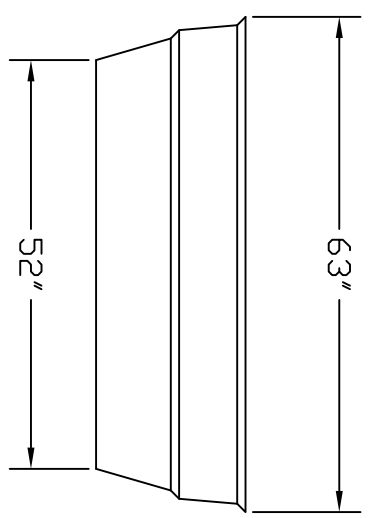

- NOTES:  
 1 LOCATE FITTINGS FROM PLAN VIEW,  
 2 TANK(S) MUST BE INSTALLED PER ASSMANN CORPORATION USAGE & GUIDELINES,  
 3 FLEXIBLE EXPANSION JOINTS MUST BE USED ON ALL SIDEWALL CONNECTIONS,  
 4 TANKS ARE BUILT PER ASTM D 1998.

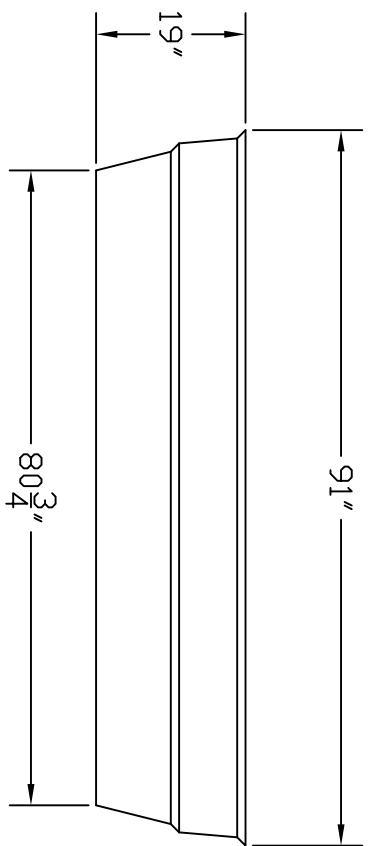

REV	REVISION DESCRIPTION	REV DATE

**Loamann** CORPORATION OF AMERICA  
 300 N TAYLOR ROAD  
 GARRETT, IN 46728  
 PHONE: (260) 357-3181  
 FAX: (260) 357-3739

TITLE: IRD 385 GALLON RECTANGULAR SECONDARY CONTAINMENT BASIN  
 DRAWN BY: SRU/WLJ/SO  
 DATE: 2/27/13  
 SALES ORDER:      

RESIN USED: POLYETHYLENE  
 TANK DESIGN: 1.9 SP.G. MAX  
 SPECIFIC GRAVITY: 1.9  
 TANK WEIGHT: 90 LBS.  
 DWG NUMBER: IRD 385  
 REV: Ø

ALL DIMENSIONS ARE IN INCHES AND ARE ±3%