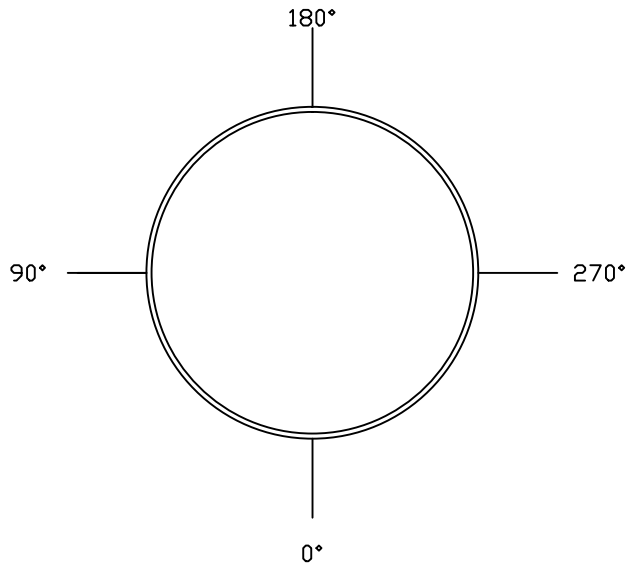

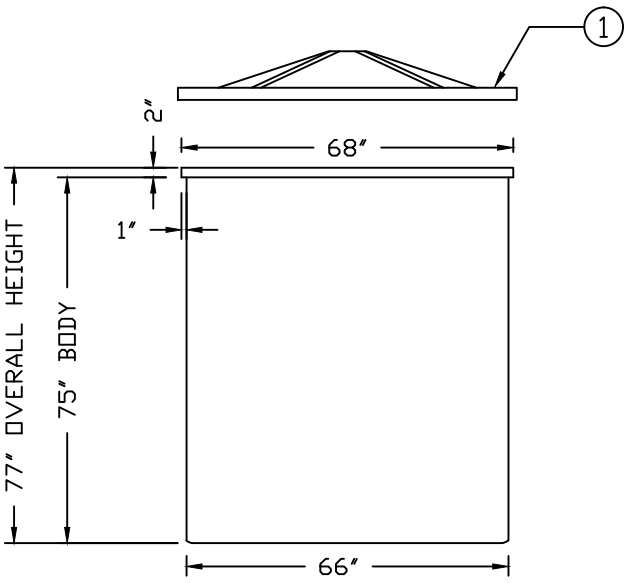

ACCESSORIES					
MK	SIZE	DESCRIPTION	DEG	ELEV	DOME

NOTES:
1 LOCATE FITTINGS FROM PLAN VIEW.
2 TANK(S) MUST BE INSTALLED PER ASSMANN CORPORATION USAGE & GUIDELINES.
3 FLEXIBLE EXPANSION JOINTS MUST BE USED ON ALL SIDEWALL CONNECTIONS.
4 TANKS ARE BUILT PER ASTM D 1998.

NOTES:
1 OPEN TOP COVER

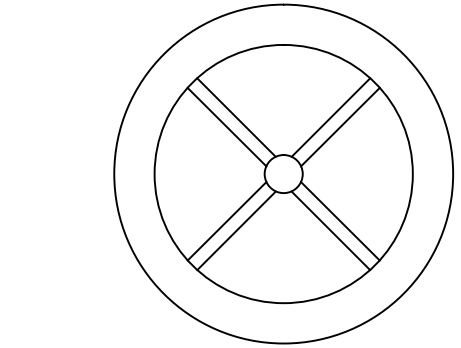

REV	REVISION DESCRIPTION	REV DATE
A	REMOVE MOLDED GALLON MARKER AND FITTING FLATS, UPDATE TANK AND LID DESIGN AND DIMENSIONS	11/14/19 DT

Assmann CORPORATION OF AMERICA
300 N TAYLOR ROAD
GARRETT, IN 46738
PHONE: (260) 357-3181
FAX: (260) 357-3738

RESIN USED:
–
–
POLYETHYLENE

TANK DESIGNED SPECIFIC GRAVITY – SP.G. MAX

TANK WEIGHT – LBS.

TANK COLOR –

TITLE IOT 1000 GAL. OPEN TOP VERTICAL STORAGE TANK

DRAWN BY:	DRAWN DATE:	CUSTOMER APPROVAL
S ROWLISON	2/7/05	

ASSMANN CORPORATION

ALL DIMENSIONS ARE IN INCHES AND ARE ±3%

DWG NUMBER: IOT 1000-N

REV: A